


Supplementary Instructions for Heater with 12" Extra Height and 4 Hydronic Coils

Important Disclaimer:

This system is for experimental use only.


Building permits, code approvals, and inspections are the responsibility of the builder or owner.

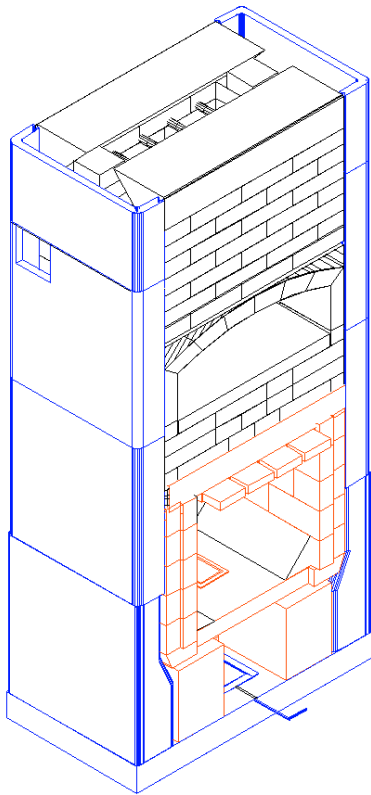

View of core, showing location of 6x6 notch for bypass damper.


In this case, the chimney is on the left side of the heater, to the rear of the heater

Additional 12" section of heat exchange channel is also shown

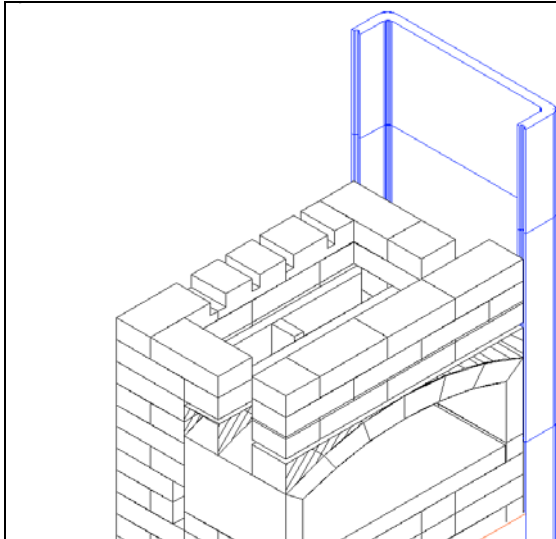


Use the standard core assembly instructions as a reference.



Notch bricks as required, similar to illustration, to receive coil assembly.

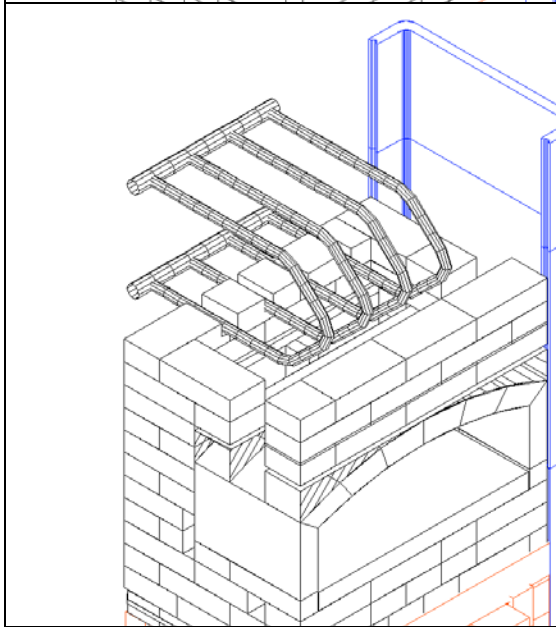


Place coil assembly (not exactly as shown)

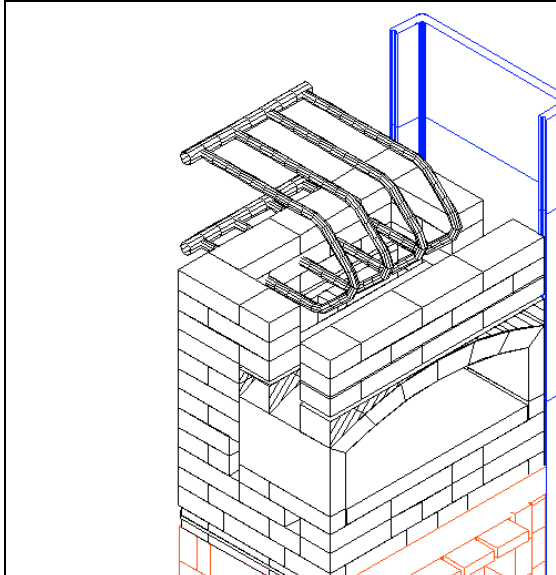

Continue as shown

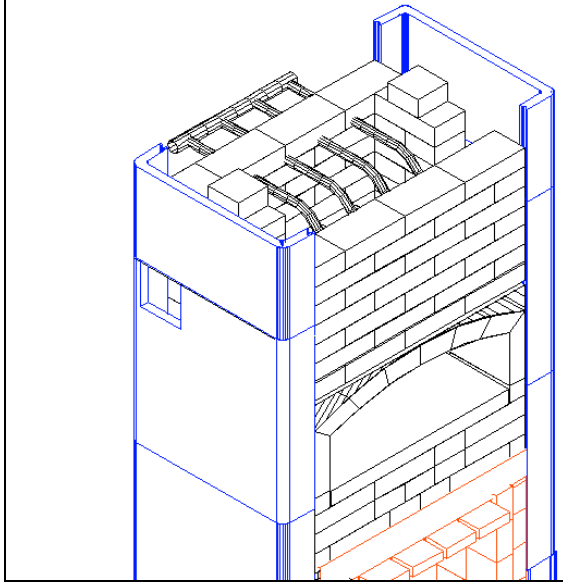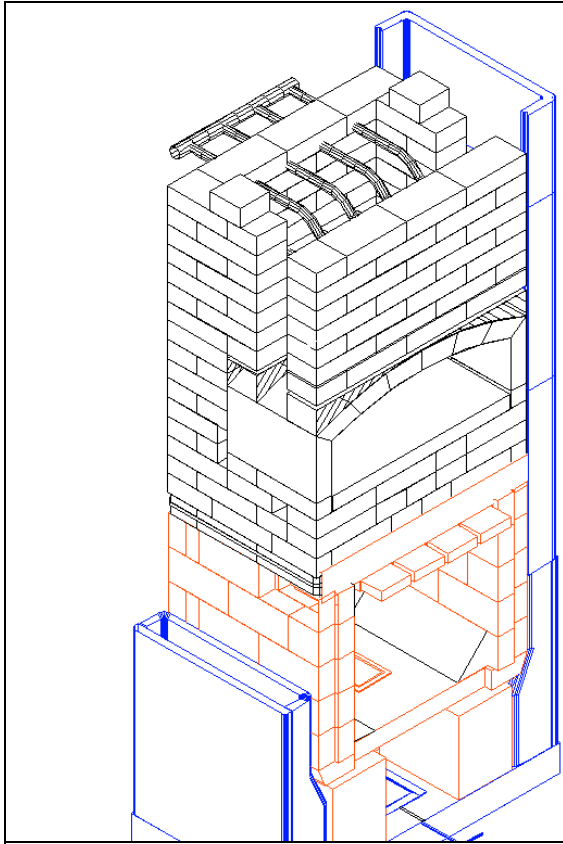

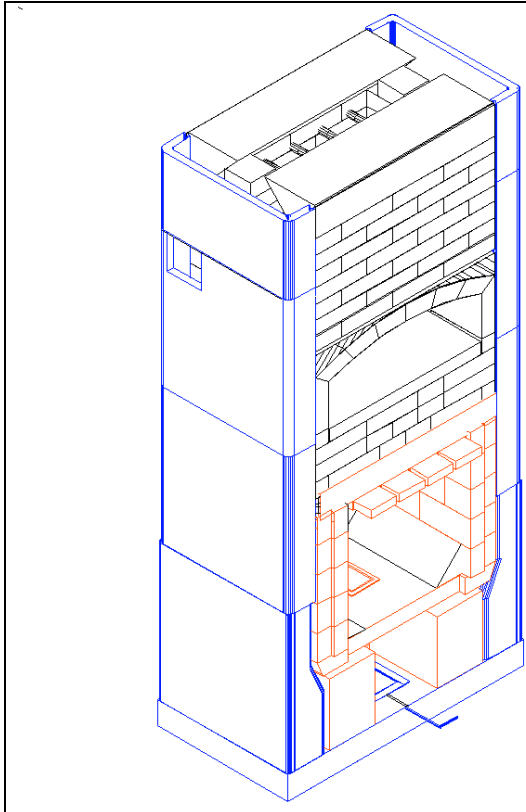

Install transition pieces as shown.

Finish by following standard assembly instructions.